



## SALT WATER SYSTEM CHLORINATOR

ITEM: 90151 / 90152 / 90153



## OWNER'S MANUAL AND SAFETY INSTRUCTIONS

SAVE THIS MANUAL: KEEP THIS MANUAL FOR SAFETY WARNINGS, PRECAUTIONS, ASSEMBLY, OPERATING, INSPECTION, MAINTENANCE AND CLEANING PROCEDURES. WRITE THE PRODUCT'S SERIAL NUMBER ON THE BACK OF THE MANUAL NEAR THE ASSEMBLY DIAGRAM (OR MONTH AND YEAR OF PURCHASE IF PRODUCT HAS NO NUMBER)

FOR QUESTIONS PLEASE CALL OUR CUSTOMER SUPPORT: 909.628.0880 MON-FRI 9AM TO 3PM PST



## GENERAL SAFETY WARNINGS

Read all safety warnings and instructions. Failure to follow the warnings and instructions may result in electric shock, fire and/or serious injury. Save all warnings and instructions for future reference.

## SAFETY

---

The warnings, precautions, and instructions discussed in this instruction manual cannot cover all possible conditions and situations that may occur. It must be understood by the operator that common sense and caution are factors which cannot be built into this product, but must be supplied by the operator. Read carefully and understand all **ASSEMBLY AND OPERATION INSTRUCTIONS** before operating. Failure to follow the safety rules and other basic safety precautions may result in serious personal injury.

- Disconnect all AC power during installation.
- **DO NOT** permit children to use this product.
- A green colored screw is located inside the wiring compartment, against the back panel. To reduce the risk of electric shock, this terminal must be connected to the grounding means provided in the electric supply service panel with a continuous copper wire equivalent in size to the circuit conductors supplying the equipment.
- One bonding lug for US models (two for Canadian models) is provided on the external surface. To reduce the risk of electric shock, connect the local common bonding grid in the area of the swimming pool, spa, or hot tub to these terminals with an insulated or bare copper conductor not smaller than 8 AWG US/6 AWG Canada.
- All field-installed metal components such as rails, ladders, drains, or other similar hardware located within 10 feet (3 meters) of the pool, spa or hot tub shall be bonded to the equipment grounding bus with copper conductors not smaller than 8 AWG US/ 6 AWG Canada.

## Operation

The SPS is an automatic chlorine generation system for pool & spa sanitation. The operation requires a low concentration of salt (sodium chloride) in the pool water at levels low enough that it normally cannot be tasted. SPS automatically sanitizes your pool by converting the salt into free chlorine, which kills bacteria and algae in the pool through a process called electrolysis.

SPS is designed to handle the purification needs of the average residential swimming pool up to 40,000 gallons (150,000 liters). The actual amount of chlorination required to properly sanitize a pool varies depending upon bather load, rainfall, air temperature, water temperature, pool's exposure to sunlight, pool's surface, and cleanliness.

**NOTE:** It is not recommended using the SPS to generate Bromine. If your pool has natural stone as coping or decking, please check with a stone installation specialist for the maintenance of the stone before installing the SPS.

## Water Chemistry

As with any pool, it is important that you maintain proper water chemistry of the pool water, including pH, alkaline content, and calcium levels. The only special requirement for SPS is to maintain proper levels of salt and stabilizer. It is important to maintain these levels in order to prevent corrosion or scaling and to ensure maximum enjoyment of the pool. Test your water periodically. It is recommended that pool water be professionally tested a minimum of twice per season. Your local pool store can provide you with the chemicals and procedures to adjust the water chemistry. Be sure to tell the pool store that you are using a salt chlorine generator.

<b>Salt</b>	<b>3200 to 4000 ppm</b>
<b>Free chlorine</b>	<b>1.0 to 3.0 ppm</b>
<b>pH</b>	<b>7.2 to 7.6</b>
<b>Cyanuric Acid (Stabilizer)</b>	<b>50 to 100 ppm</b>
<b>Total Alkalinity</b>	<b>80 to 120 ppm</b>
<b>Calcium Hardness</b>	<b>200 to 400 ppm</b>
<b>Metals</b>	<b>0 ppm</b>
<b>Saturation Index</b>	<b>-.2 to .2</b>

## Saturation Index


The saturation index (Si) relates to the calcium and alkalinity in the water and is an indicator of the pool water "balance". Your water is properly balanced if the Si is 0 ±.2. If the Si is below -0.2, the water is corrosive and plaster pool walls will be dissolved into the water. If the Si is above +0.2, scaling and staining will occur. Use the chart below to determine the saturation index.

$$\text{Si} = \text{pH} + \text{Ti} + \text{Ci} + \text{Ai} - 12.1$$

°C	°F	Ti	Calcium Hardness	Ci	Total Alkalinity	Ai
12	53	.3	75	1.5	75	1.9
16	60	.4	100	1.6	100	2.0
19	66	.5	125	1.7	125	2.1
24	76	.6	150	1.8	150	2.2
29	84	.7	200	1.9	200	2.3
34	94	.8	250	2.0	250	2.4
39	103	.9	300	2.1	300	2.5
			400	2.2	400	2.6
			600	2.4	600	2.8
			800	2.5	800	2.9

# OPERATION

**HOW TO USE:** Measure pool pH, temperature, calcium hardness, and total alkalinity. Use the chart above to determine Ti, Ci, and Ai from your measurements. Insert values of pH, Ti, Ci and Ai into the above equation. If Si equals .2 or more, scaling and staining may occur. If Si equals -.2 or less corrosion or irritation may occur.

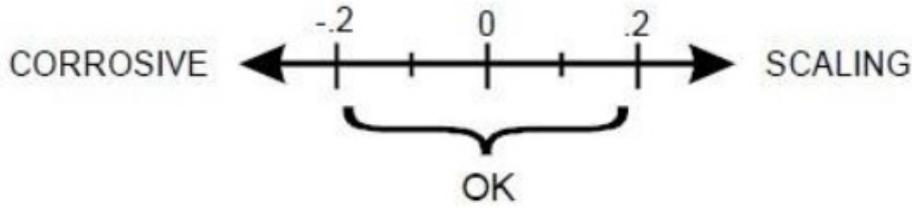

## Salt Level:

Use the chart below to determine the amount of salt needs to be added to reach the recommended levels. Use the equations below to determine the size of your pool.

	Gallons (pool size feet)	Liters (pool size in meters)
<b>Rectangular</b>	Length×Width×Average Depth×7.5	Length×Width×Average Depth×1000
<b>Round</b>	Diameter×Diameter×Average Depth×5.9	Diameter×Diameter×Average Depth×785
<b>Oval</b>	Length×Width×Average Depth×6.7	Length×Width×Average Depth×893

- The ideal salt level is between 3200-4000 ppm. (parts per million) with 3600 ppm being the optimal level. Calculate the number of gallons in the pool and add salt according to the chart.
- A LOW salt level will reduce the efficiency of the SPS and result in low chlorine production.
- Excessively HIGH salt levels will cause the SPS to shut down, making pool water unsafe for bathers. LOW salt levels can cause the SPS not to operate efficiently, causing the same.

## Type of Salt to Use:

is important to use only sodium chloride (NaCl) that is 99% pure. This is common food quality or water softener salt available in 40-80 lb/bag at your local store. It is also acceptable to use water conditioning salt pellets; however it will take longer for them to dissolve. Do not use rock salt, salt with more than 1% yellow prussiate of soda, salt with more than 1% of anti-caking additives, or iodized salt.

## Type of Salt to Use:

- **IN GROUND POOLS:** Turn the filter pump on and add the salt directly into the pool at the shallow end.
- **ABOVE GROUND POOLS WITH MAIN DRAINS:** Add directly in front of the return jet to pool. Run the filter pump for 24 hours with the suction coming from the main drain (use the pool vacuum if there is no main drain) to allow the salt to evenly disperse throughout the pool.
- **ABOVE GROUND POOLS WITHOUT MAIN DRAINS:** Add directly into the pool. Brush the salt to speed up the dissolving process—to not allow the salt to sit in a pile on the bottom of the pool. -----ELIMINATE THE FOLLOWING--(Run the filter pump for 24 hours with the suction coming from the main drain (use the pool vacuum if there is no main drain) to allow the salt to evenly disperse throughout the pool).

**ON ANY POOL, DO NOT ADD SALT DIRECTLY TO THE SKIMMERS OR DIRECTLY ONTO THE MAIN DRAIN. THIS WILL SHUT DOWN OR SHORTEN THE LIFE OF THE CELL DUE TO HIGH SALT CONCENTRATION AND REDUCED FLOW TO THE PUMP.**

If added incorrectly, immediately turn off SPS for 24 hours with the pump and filter operating This will help to evenly distribute the salt. The salt display may take 24 hours to respond to the change in salt concentration.

# APPLICATIONS

## SALT DOES NOT EVAPORATE FROM POOL

The only way to lower the salt concentration is to partially drain the pool and refill with fresh water.

### POUNDS and (Kg) OF SALT NEEDED FOR 3200 PPM

#### Gallons and (Liters) of Pool/Spa water

Current salt level ppm	6,000 (22,500)	8,000 (30,000)	10,000 (37,500)	12,000 (45,000)	14,000 (52,500)	16,000 (60,000)	18,000 (67,500)
0	180 (82)	239 (109)	301 (136)	360 (163)	419 (190)	481 (218)	540 (245)
200	170 (78)	226 (103)	284 (129)	340 (154)	396 (180)	454 (206)	510 (232)
400	160 (73)	213 (97)	267 (121)	320 (145)	373 (170)	427 (194)	480 (218)
600	150 (69)	200 (91)	250 (114)	300 (136)	350 (159)	400 (182)	450 (205)
800	140 (64)	187 (85)	233 (106)	280 (127)	327 (148)	373 (170)	420 (191)
1000	130 (59)	173 (79)	217 (98)	260 (118)	303 (138)	347 (158)	390 (177)
1200	120 (55)	160 (73)	200 (91)	240 (109)	280 (127)	320 (145)	360 (164)
1400	110 (51)	147 (67)	183 (83)	220 (100)	257 (117)	293 (133)	330 (150)
1600	100 (46)	133 (61)	167 (76)	200 (91)	233 (106)	267 (121)	300 (136)
1800	90 (41)	120 (55)	150 (68)	180 (82)	210 (95)	240 (109)	270 (123)
2000	80 (36)	107 (48)	133 (61)	160 (73)	187 (85)	213 (97)	240 (109)
2200	70 (32)	93 (42)	117 (53)	140 (64)	163 (74)	187 (85)	210 (95)
2400	60 (27)	80 (36)	100 (45)	120 (55)	140 (64)	160 (73)	180 (82)
2600	50 (23)	67 (30)	83 (38)	100 (45)	117 (53)	133 (61)	150 (68)
2800	40 (18)	53 (24)	67 (30)	80 (36)	93 (42)	107 (48)	120 (55)
3000	30 (14)	40 (18)	50 (23)	60 (27)	70 (32)	80 (36)	90 (41)
3200	20 (9)	27 (12)	33 (15)	40 (18)	47 (21)	53 (24)	60 (27)
3400	10 (4)	13 (6)	17 (8)	20 (9)	23 (11)	27 (12)	30 (14)
3600+	Ideal	Ideal	Ideal	Ideal	Ideal	Ideal	Ideal
3800	OK	OK	OK	OK	OK	OK	OK
4000	OK	OK	OK	OK	OK	OK	OK
4200	High	High	High	High	High	High	High
4400	Dilute	Dilute	Dilute	Dilute	Dilute	Dilute	Dilute

# OPERATION

## STABILIZER (CYANURIC ACID)

Always test for stabilizer (cyanuric acid) level, when testing for salt. This test should be done at least once per month. Use the chart below to determine how much stabilizer must be added to raise the level to 80 ppm .

## POUNDS and (Kg) OF STABILIZER (CYANURIC ACID) NEEDED FOR 80 PPM

Gallons and (Liters) of Pool/Spa water

Current Stabilizer Level(ppm)	6,000 (22500)	8,000 (30000)	10,000 (37500)	12,000 (45000)	14,000 (52500)	16,000 (60000)	18,000 (67500)
0 ppm	4.0 (1.8)	5.3 (2.4)	6.7 (3.0)	8.0 (3.6)	9.4 (4.3)	10.7 (4.9)	12.0 (5.4)
10 ppm	3.5 (1.6)	4.7 (2.1)	5.8 (2.6)	7.0 (3.2)	8.2 (3.7)	9.4 (4.3)	10.5 (4.8)
20 ppm	3.0 (1.4)	4.0 (1.8)	5.0 (2.3)	6.0 (2.7)	7.0 (3.2)	8.0 (3.6)	9.0 (4.1)
30 ppm	2.5 (1.1)	3.3 (1.5)	4.2 (1.9)	5.0 (2.3)	5.9 (2.7)	6.7 (3.0)	7.5 (3.4)
40 ppm	2.0 (.9)	2.7 (1.2)	3.3 (1.5)	4.0 (1.8)	4.7 (2.1)	5.4 (2.4)	6.0 (2.7)
50 ppm	1.5 (.7)	2.0 (.9)	2.5 (1.1)	3.0 (1.4)	3.5 (1.6)	4.0 (1.8)	4.5 (2.0)
60 ppm	1.0 (.5)	1.3 (.6)	1.7 (.8)	2.0 (.91)	2.4 (1.1)	2.7 (1.2)	3.0 (1.4)
70 ppm	0.5 (.2)	0.7 (.3)	0.8 (.4)	1.0 (.45)	1.2 (.54)	1.4 (.64)	1.5 (.68)
80 ppm	0.0	0.0	0.0	0.0	0.0	0.0	0.0

## POLYMERS:

It is advised to use polymers (commonly sold as poly algaecide) on salt water sanitizing systems. The poly algaecide is sold in 30% and 60% concentrations. Application rate is 1 quart of Poly30 (or ½ quart of Poly 60) per 15,000 gallons (60,000 liters) of pool water, per month. Apply directly in front of the return jet.

## CONTROLS

### MAIN SWITCH

- **AUTO:** For normal operation, the Main switch should be left in the AUTO position. In this position the SPS will produce chlorine according to the “Desired Level %” adjustment setting for the entire filtering / pumping cycle.
- **SUPER CHLORINATE:** When you have an abnormally high bather load, heavy rainfall, cloudy water conditions, or any other condition which requires that a large amount of purification be introduced, set the Main Switch in the SUPER CHLORINATE position. This electronically “super chlorinates” (shocks) the water for 24 hours (filter pump must be on during this time) or until the power has been turned off, whichever comes first. At the end of the super chlorination period, be sure to put the switch back into the AUTO position.
- **OFF:** The OFF position prevents the SPS from energizing the electrolytic cell. In this position there is no chlorine generation.

**NOTE:** In times of servicing, the OFF switch is not to be used. To service the SPS, turn power off the circuit breaker.

### DESIRED LEVEL ADJUSTMENT KNOB

This setting is used to control the amount of chlorine the SPS generates. Adjust this setting to increase or decrease the chlorine output level. The reading is from 5 percent output to 100% output capacity of the SPS.

### INDICATOR LED

- **POWER:** When illuminated, the SPS has input power.
- **SUPER CHLORINATE:** Illuminates during Super Chlorination. See description above.
- **REMOTE CONTROLLED:** The part is controlled by a remote control system.
- **NO FLOW:** When illuminated, the flow switch has detected no flow and SPS is NOT generating chlorine. A flashing LED indicates that the flow is restored, but there will be a 60 second delay before generation is reestablished.
- **CHECK SALT:** When flashing, the salt level is low (below 2500ppm) and SPS is generating at low efficiency. When illuminated steady, the salt level is too low and SPS has shut down.

**NOTE:** Before adding large quantities of salt, it is advisable to have your salt level professionally checked.

- **HIGH SALT:** When illuminated, the salt level is too high and SPS has shut down. The pool water must be diluted with fresh water before operation is restored.
- **INSPECT CELL:** If flashing, either the cell efficiency is reduced or it is time for regularly scheduled cell inspection. In either case, inspect the cell and clean if necessary. Pressing the “diagnostic” button next to the display for 3 seconds will stop the flashing LED. When illuminated steady, cell efficiency is greatly reduced and SPS has stopped producing chlorine. Inspect, clean or replace if necessary.

### SALT DISPLAY

The Salt Display shows the current salt concentration of the pool water. Readings are in ppm (parts per million). If Metric units (grams per liter) are preferred, push the “diagnostic” button next to the display once. The display will now show the pool water temperature in degrees Fahrenheit. With the temperature displayed, move the main switch from AUTO to SUPER CHLORINATE to AUTO. The temperature display will instantly change to degrees Celsius. Repeat this process to switch back to USA units (Fahrenheit).

# OPERATION

## Diagnostic Displays:

Sequential pushes of the small “diagnostic” button next to the LCD display will cause the Aqua Rite to display the following information:

1. Pool temperature (xx degrees Fahrenheit or Celsius)
2. Cell voltage (typically 21.0 to 27.0 volts when chlorine is being generated, otherwise 16-25V)
3. Cell current (typically 2.50 to 7.80 amps when chlorine is being generated, otherwise 0 amps)
4. Desired Output % (“0P” -- “100P” depending on knob position or input from remote pool automation controller)
5. Instant salinity ( -xxxx ppm or -x.xx grams/Liter)
6. Product name sent to the pool automation control display
7. Software revision level
8. Cell type.

On the 8th push of the button the display will revert back to the default salt display. Also, if the button is not pushed for 30 seconds, the display will revert back too.

## OPERATION

By familiarizing yourself with the operation of the SPS generator, you can achieve maximum performance for your pool. When chemical levels are in the recommended range, there are FOUR factors that you can control which directly contribute to the amount of chlorine the SPS will generate:

- **Filter time each day (hours)**
- **The amount of salt in the pool**
- **The “Desired Level %” setting**
- **Stabilizer level in the water**

To find the optimum “Desired Level %” setting, start at a fairly high setting and work downward. It will take a few days of adjustments to find the ideal setting for your pool. Once determined, it should only take minor adjustments. The SPS control will not produce chlorine at temperatures below 50°F. If your pool water is colder than 50°F, you must chlorinate manually.

## Maintaining the System

To maintain maximum performance, it is recommended that you remove and visually inspect the cell every 3 months. The SPS will remind you to do this by flashing the “Inspect Cell” LED after approximately 500 hours of operation. After you inspect the cell (and clean, if necessary) press the small “diagnostic” button next to the display for 3 seconds to stop the flashing “Inspect Cell” LED and start the timer for the next 500 hour inspection period.

The SPS electrolytic cell has a self-cleaning feature incorporated into the electronic control’s logic. In most cases this self-cleaning action will keep the cell working at optimum efficiency. In areas where water is hard (high calcium and/or mineral content) and in pools where the water chemistry has gotten “out of balance”, the cell may require periodic cleaning. The “Inspect Cell” LED remains on after a thorough cleaning, the cell may be worn and may require replacement.

# OPERATION

## Servicing and Cleaning the cell

- Turn off power to the SPS before removing the CELL.
- Once removed, look inside the cell and inspect for scale formation (light colored crusty or flaky deposits) on the plates and for any debris that has passed through the filter and gotten caught on the plates.
- If no deposits are visible, reinstall. If deposits are seen, use a high-pressure garden hose and try to flush the scale off. If this is not successful, use a plastic or wood tool to scrape deposits off of the plates. **DO NOT USE A METAL SCRAPER AS THIS WILL SCRATCH THE FINISH AND DAMAGE THE PLATES.** Note that a buildup on the cell indicates that there is an unusually high calcium level in the pool (old pool water is usually the cause). If this is not corrected, you will need to clean the cell more frequently. The simplest way to avoid this is to bring the pool chemistry to recommended levels, as specified.

## Mild Acid Washing:

Use only in severe cases where flushing and scraping will not remove the majority of deposits. To acid wash:

- Turn off power to SPS
- Remove cell from piping
- In a clean plastic container, carefully mix a 4:1 solution of water to muriatic acid (one gallon of water to one quart of muriatic acid).

**ALWAYS POUR ACID INTO WATER-NEVER POUR WATER INTO ACID. BE SURE TO WEAR PROTECTIVE GLASSES, CLOTHING AND CHEMICAL RESISTANT GLOVES**

- The level of the solution in the container should just reach the top of the cell so that the wire harness compartment is NOT submerged. It may be helpful to coil the wiring before immersing the cell.
- The cell should soak for FIVE minutes, then rinse with a high-pressure garden hose.
- If any deposits are still visible, repeat soaking and rinsing.
- Replace cell and inspect again periodically.

## Winterizing

The SPS electrolytic cell and flow detection switch will be damaged by freezing water, similar to other pool components that require proper winterization. In areas of the country that experience severe or extended periods of freezing temperatures, be sure to drain all water from the pump, filter, and supply and return lines before any freezing conditions occur. The electronic control is capable of withstanding any winter weather and should not be removed.

## Spring Start-up

**DO NOT** turn SPS on, until the pool water chemistry has been balanced to proper levels.

## INSTALLATION

Installation must be performed in accordance with Local NEC codes.

### Preparing Pool Water:

The pool's chemistry must be balanced BEFORE activating the SPS. It is recommended that you consult a pool professional for the initial balancing each season. NOTE: At the beginning of each season, add metal remover and polymer based (non copper) algaecide to the pool, per manufacturer's instructions. This ensures a quick, trouble free transfer to the SPS system.

### Mounting the SPS Control

The SPS is contained in a rain tight enclosure that is suitable for outdoor mounting. The control must be mounted a minimum of 5 ft. (2 meters) horizontal distance (or more if local codes require) from the pool/spa. The control is designed to mount vertically on a flat surface with the knockouts facing downward. Because the enclosure also acts as a heat sink (disperses heat from inside the box), it is important not to block the four sides of the control. Do not mount the SPS in a panel or tightly enclosed space.

### Plumbing

Ensure that the SPS installation does not constitute a cross connection with the local potable water supply. Consult local plumbing codes. The cell and flow switch are plumbed in the return line to the pool. Install after (downstream) all the pool equipment (filter, heater, solar, etc.). The kit included in the SPS provides the necessary plumbing components for:

- 2" (51mm) rigid PVC piping installation for in ground pools
- 1 1/2-1 1/4" (38-32mm) flexible hose connections for above ground pools

For proper plumbing, refer to the overview diagram below



### Flow switch:

**IMPORTANT:** To insure proper operation, verify that the arrow on the flow switch (located on the side) points in the same direction of water flow.


# OPERATION

## Electrolytic Cell:

Install using the unions provided. Tighten by HAND for a watertight seal. For pool/spa combination systems with spillover, use configurations #2 or #3 above to allow chlorination for both the pool and spa during spillover but preventing over chlorination when operating the spa only.

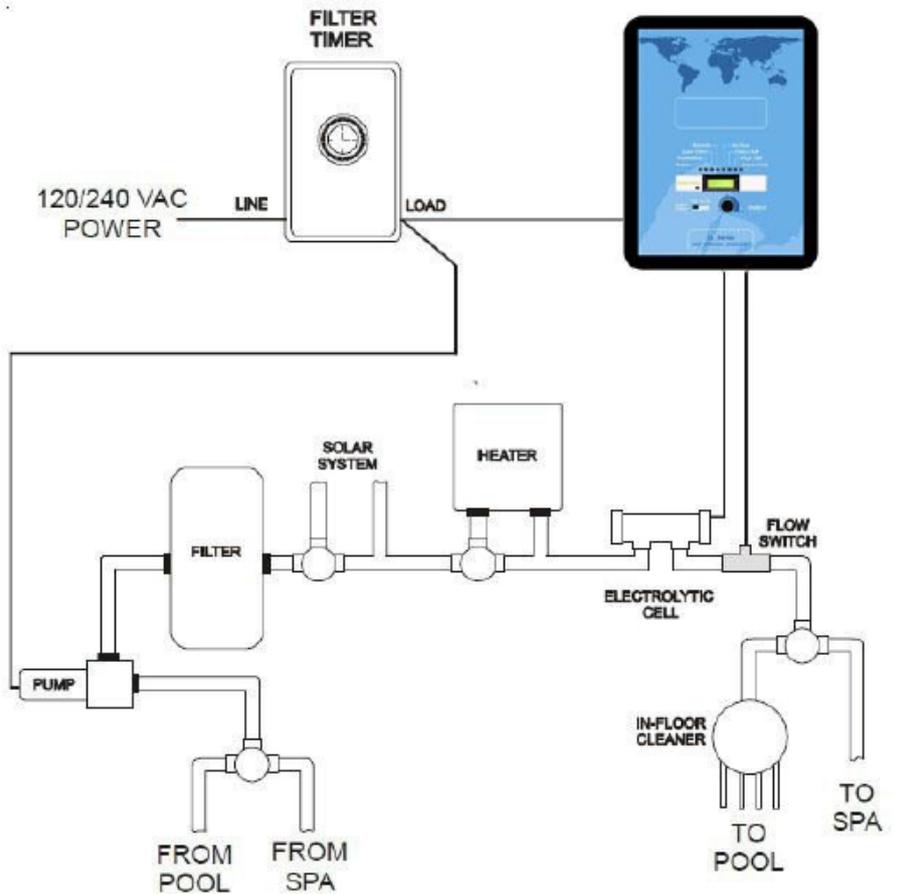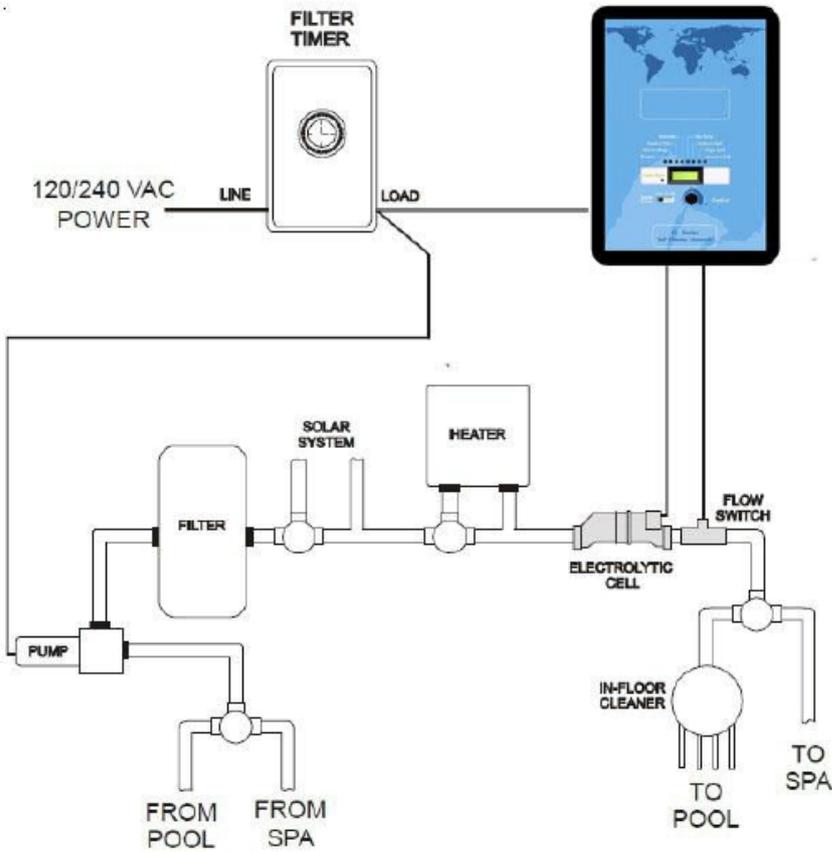

# OPERATION

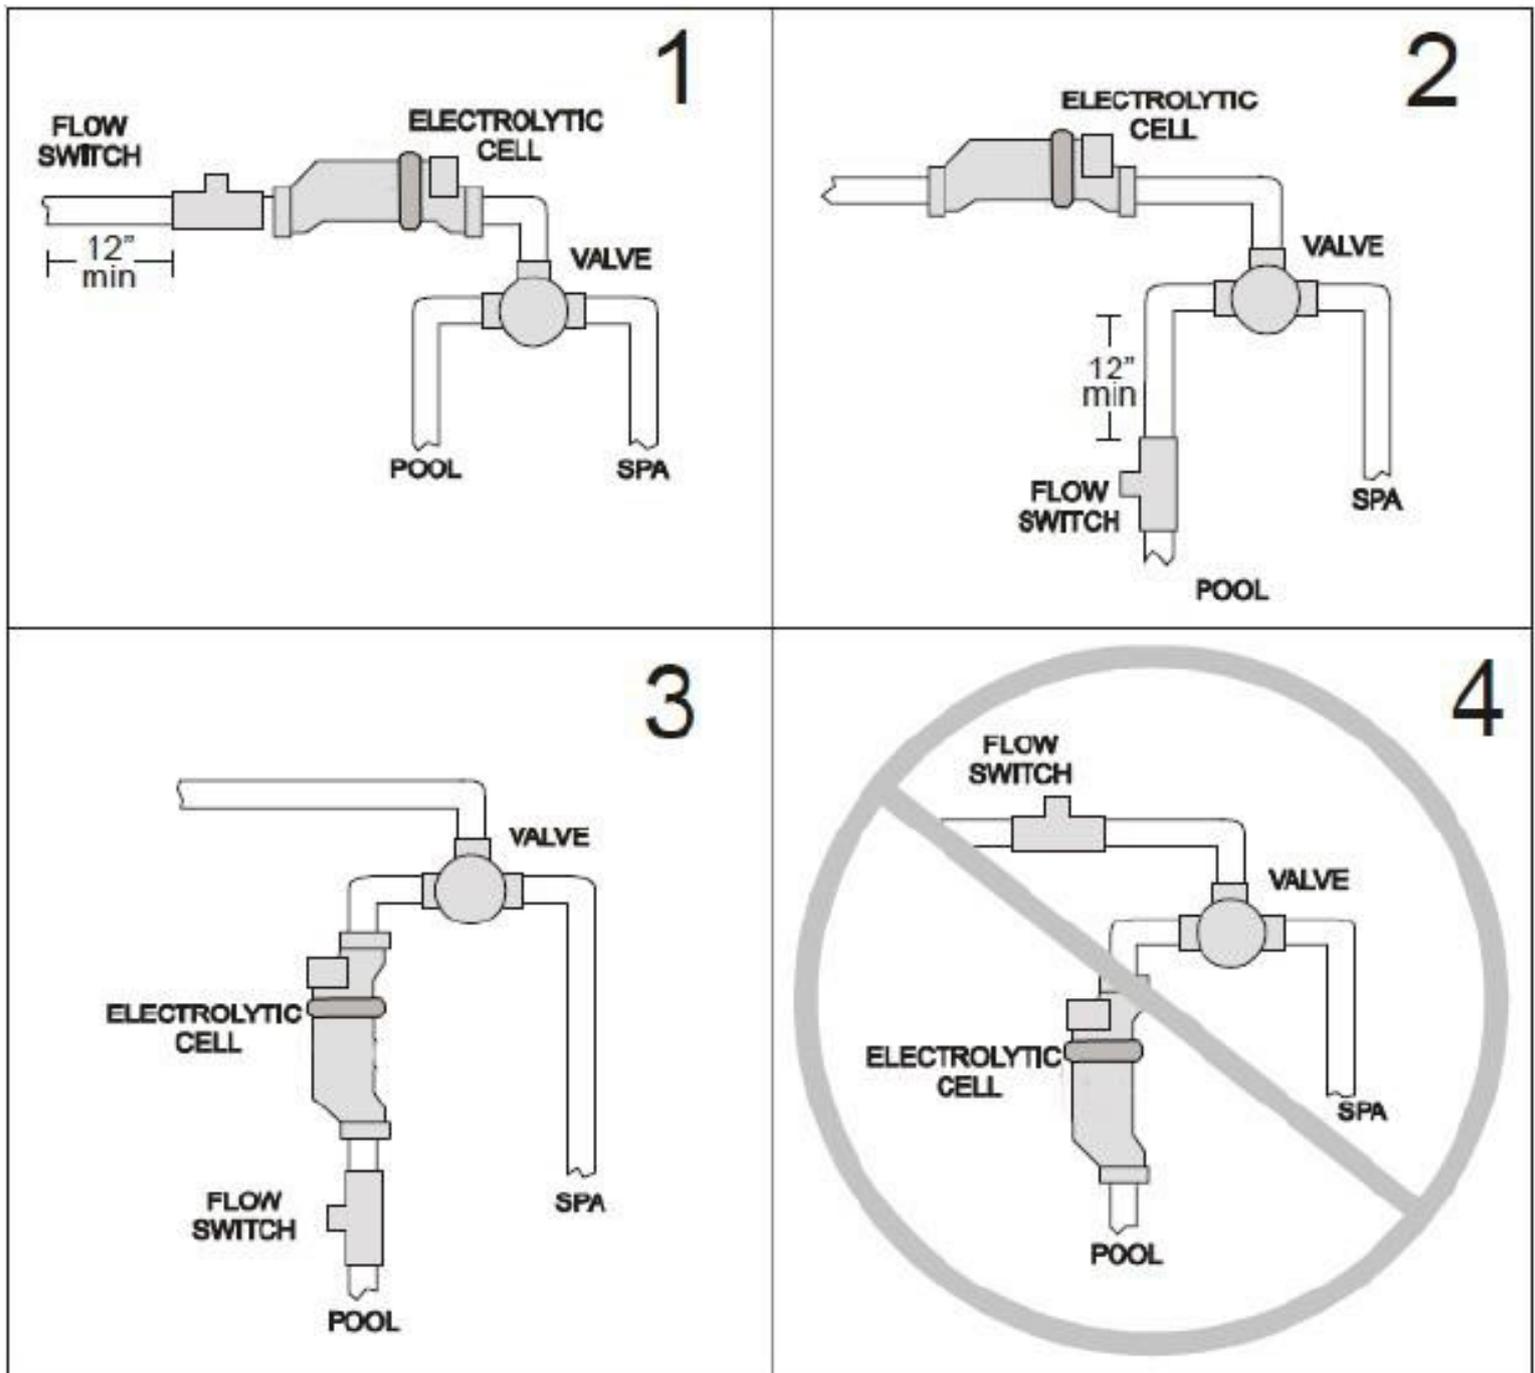

## Plumbing

Power must be turned off at the circuit breaker before performing any wiring. Be sure to follow Local and NEC electrical codes. To provide safe operation, SPS must be properly grounded and bonded.

Input Power for stand-alone operation:


Wire the SPS to the LOAD SIDE of the filter pump timer. It is very important that the SPS is powered only when the pump is running.

Refer to the wiring label on SPS as well as the diagram below to determine correct wiring connections. The SPS is shipped from the factory with the configuration jumpers in a separate bag. Until the jumpers are installed for the desired voltage, the unit should NOT be turned on.


- For Canadian models, the SPS shall be connected to a circuit protected by a class A ground fault interrupter. Be sure to connect the GROUND wire to the green ground screw terminal located on the INSIDE WALL of the enclosure.

# OPERATION


## TYPICAL 240 VAC WIRING

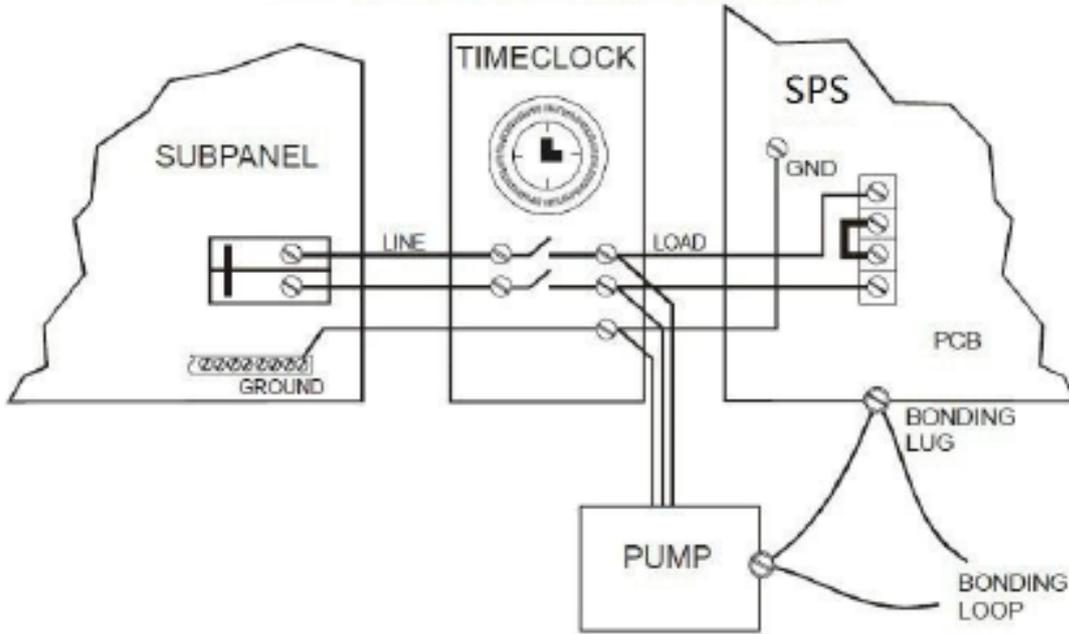

## 120 VAC

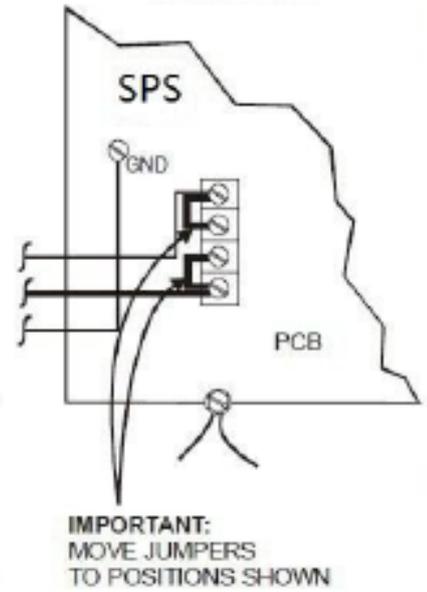

## GOLDLINE, PENTAIR or POLARIS

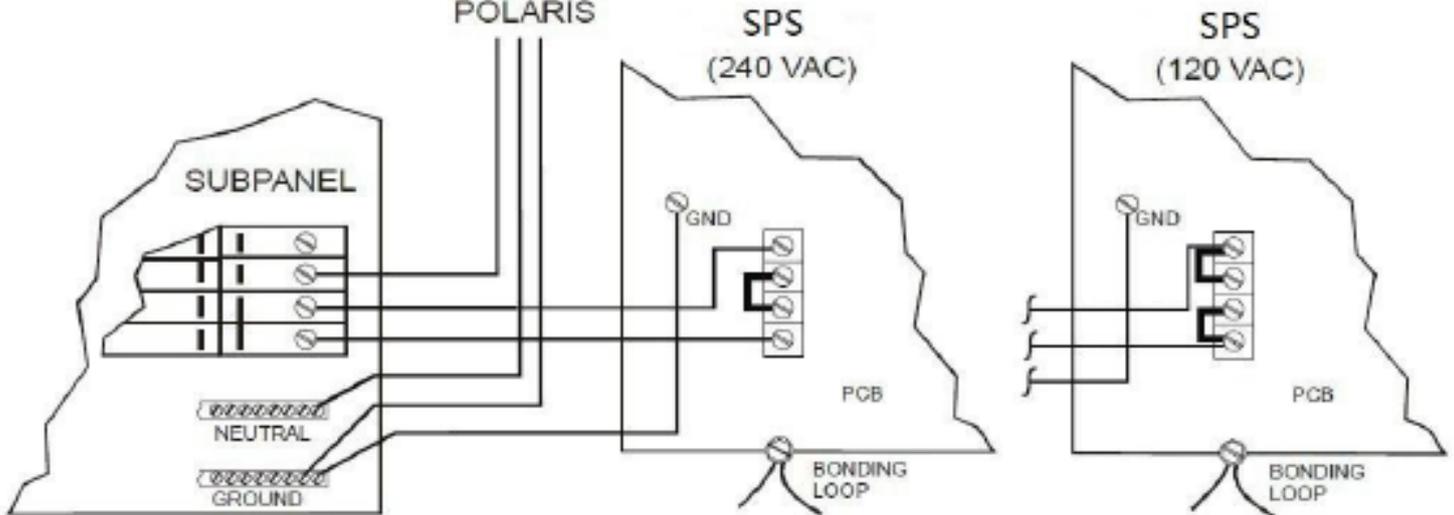

**NOTE:** Wire the pump directly to the time clock—do not use the SPS as a junction box.


### Bonding:

A lug used for bonding is attached to the bottom of the SPS enclosure (see diagram below). The SPS must be bonded with an 8 AWG copper wire (6 AWG Canada) to the pool bonding system.

### Electrolytic Cell and Flow Switch:

The electrolytic cell and flow switch cables are terminated with connectors that plug into the SPS for easy attachment and removal. The door of the SPS must be open to access the cell cable connector. The flow switch plugs into a connector (similar to a telephone jack) located outside, on the bottom of the enclosure. Refer to the diagram below for the location of these connections.


# OPERATION

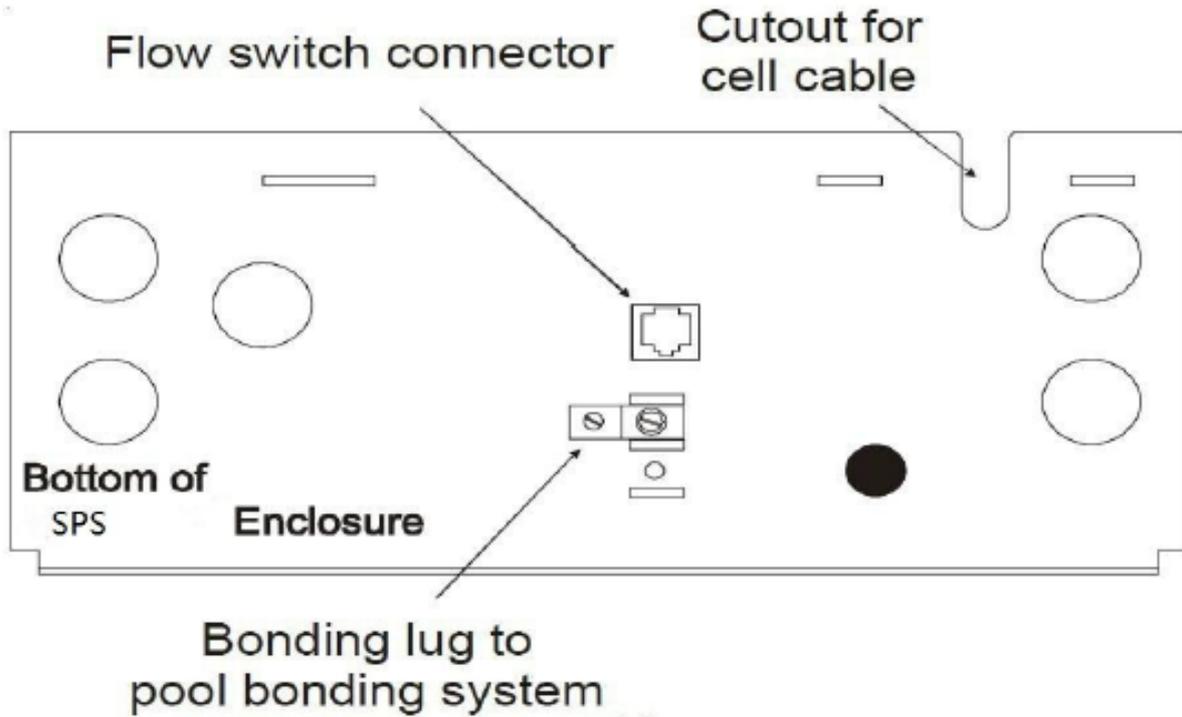


Input power for use with Goldline, Pentair and Polaris controls: Wire the SPS® DIRECTLY TO 120/240vac POWER (not through timer or relay). Optional Goldline, Pentair and Polaris controls: The Goldline, Pentair and Polaris controls use a 4 wire connection to communicate to the SPS and can be wire up to 500' apart. Any outdoor rated 4 conductor cable can be used. Refer to each manufacturer's instructions and the wiring diagrams below for proper wiring connection to the SPS.

**NOTE:** There must be only 1 "primary" unit. All other SPS units must be configured as "secondary".

**Goldline:** Attach wires to proper screw terminals as show below.

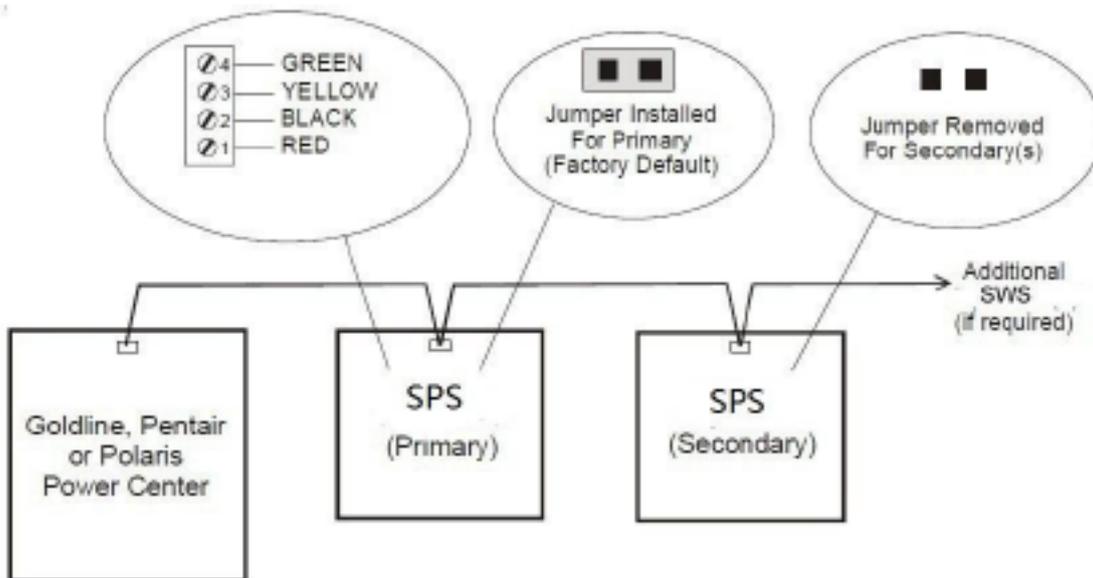


**Goldline** - Attach wires to proper screw terminals as shown below.

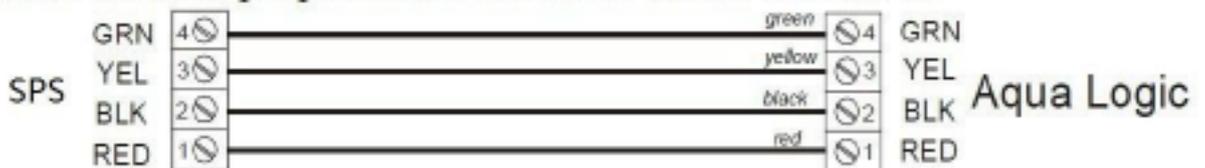


Attach wires to opposite numbered screw terminals as shown below. Note that the colors marked on the Pentair PCB do not match the SPS.

# OPERATION AND TROUBLESHOOTING

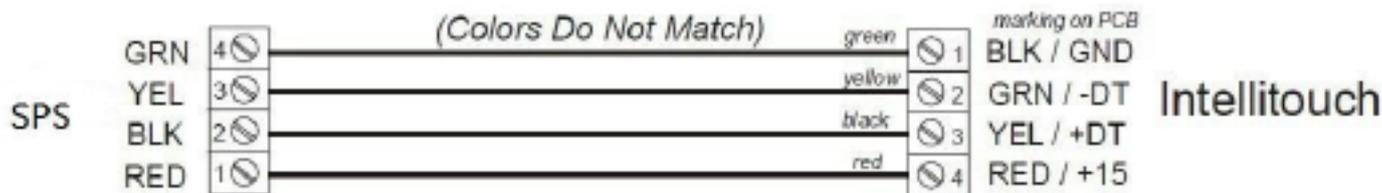

Polaris-Attach wires to proper screw terminals as shown below. Note that screw terminal "1" is marked on the Polaris PCB.

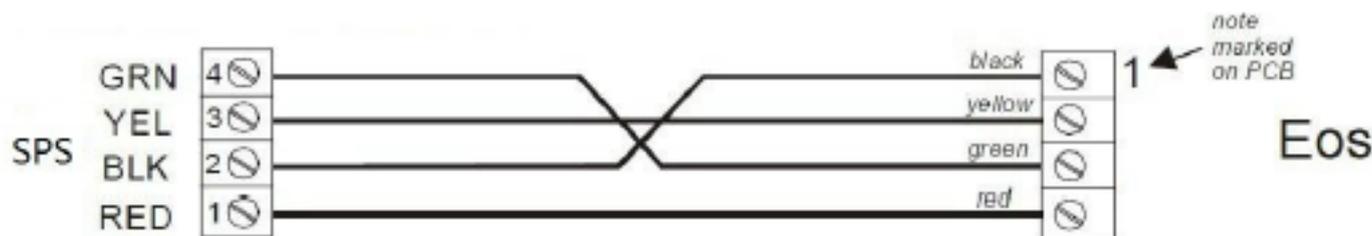

## TROUBLESHOOTING

### Diagnostic Displays

Sequential pushes of the small "diagnostic" button next to the LCD display will cause the SPS to display the following information:

1. Pool temperature (xx degrees Fahrenheit or Celsius)
2. Cell voltage (typically 21.0 to 27.0 volts when chlorine is being generated, otherwise 16-25V)
3. Cell current (typically 2.50 to 7.80 amps when chlorine is being generated, otherwise 0 amps)
4. Desired Output % ("0P" -- "100P" depending on knob position controller)
5. Instant salinity ( -xxxx ppm or -x.xx grams/Liter)
6. Product name sent to the pool automation control display
7. Software revision level
8. Cell type.

On the 8th push of the button the display will revert back to the default salt display. Also if the button is not pushed for 30 seconds, the display will revert back default salt.

### Diagnostic Displays

#### "Power" LED not on:

Check to make sure 120 / 240 VAC input power is connected to the control. Be sure the jumpers are set properly. Verify input voltage with a voltmeter. If there is input power, the fuse may have blown. The board is protected by a 20 amp mini ATO fuse located on the circuit board above the cell connector.

#### "Generating" LED flashing:

The temperature of the pool water is too high or low to operate. You can override this by switching the main switch to SUPER CHLORINATE. The SPS will run at maximum output for the remainder of the current pump cycle or 24 hours, whichever comes first.

## How to replace CFT

**Step 1.** Turn off the power to the pump and chlorine salt generator. Ideally this should be done at the circuit breaker. The controller display should go blank.



**Step 2.** Relieve the water pressure at the relief valve, it is usually on top of your pool filter.

**Step 3.** Unscrew the threads on both sides of the original T cell.



**Step 4.** Original AquaRite Turbo Cell out from the piping.

**Step 5.** Pull the plug out at the lower corner of the digital controller.



**Step 6.** Inspect the O-rings inside the union connected with the pipe for any wear and replace them if possible. Apply a thin layer of lubricant to the O-ring.

# OPERATION

**Step 7.** Place the CFT cell into the piping and screw the unions back onto the ends of the new cell. Tighten the thread. The cell can be positioned either way. In fact, we suggest to reverse the cell every time you clean it to extend the life of the cell.



**Step 8.** Plug the power cord into the lower corner of the controller.


**Step 9.** Restart the pool pump and salt chlorine generator. The controller should light up and the pool pump should operate.

**Step 10.** Any air in the duct should be drained from the open safety valve. When the water begins to squirt from the safety valve, close the valve.



**Step 11.** After a couple of minutes, the controller display will show a salt value of between 2700 and 3400 and the “Power” and “Generating” LEDs should be light on.

# PARTS LIST

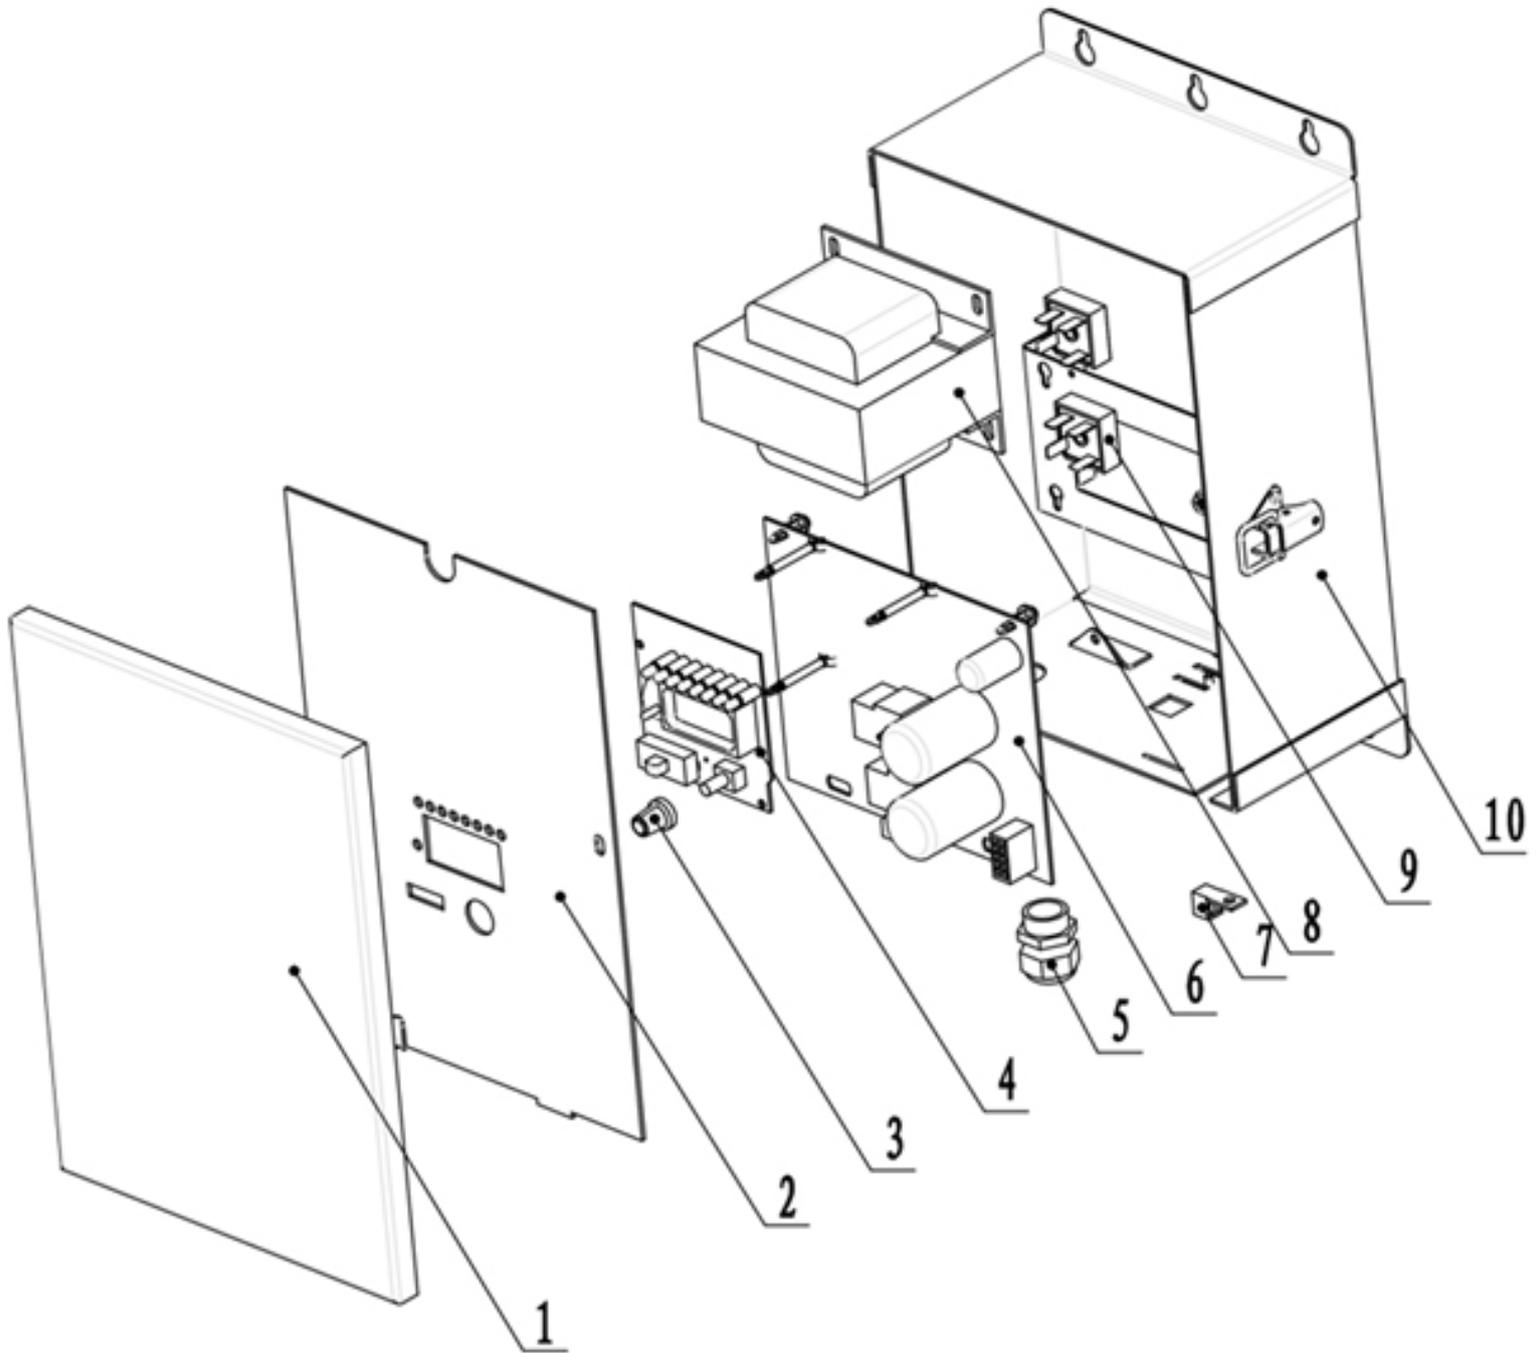

01	Top cover	10	Case
05	PG9.0	03	Key cap
09	Bridge rectifier	07	Ground
02	Panel	04	PCB
06	PCB	08	Transformer

# TROUBLESHOOTING

## **“No Flow” LED illuminated or flashing:**

The SPS has sensed a no flow condition and has stopped generating chlorine. Check that the flow switch is plugged into the connector on the bottom of the control unit and that the wire is not cut or damaged. Make sure you have at least 12” of straight pipe before the flow switch. If there is adequate flow and the LED is still on, check that the arrows on the flow switch (on top of hex) are pointing in the direction of flow. If the light is flashing, the flow is established and the SPS will turn on within 1 minute.

## **“Check Salt” LED illuminated or flashing:**

Check salt level in pool/spa. If salt level is low, add salt according to chart on page 4. Before adding large quantities of salt, it is advisable to have your salt level professionally checked.

## **“High Salt” LED illuminated:**

Check salt level in pool/spa. If salt level is too high, lower salt level by draining some of the pool water out of the pool and replace with fresh water. Continue until the salt concentration is at recommended levels.

## **“Inspect Cell” LED flashing:**

Inspect and clean cell according to directions. When done, press the “diagnostic” button for 3 seconds to stop the “Inspect Cell” LED flashing.

## **“Inspect Cell” LED illuminated:**

Remove and inspect the cell for scale. If the cell is scaled, follow the directions on page 8 for cell cleaning. If the pool has the proper amount of salt and the “Inspect Cell” LED is still illuminated, the cell may be depleted and needs to be replaced.

## **Diagnostic Displays**

- SPS switch in OFF position.
- Desired Level% adjustment setting is too low.
- Low stabilizer (Cyanuric Acid). Chlorine is being produced but the pool water is unable to hold on to the chlorine, due to low stabilizer.
- Filter pump switched off or filter pump time too short (8 hours for average size pools, more for large pools).
- Salt level too low (below 2500 ppm, Low Salt LED on).
- Salt level too high (high Salt LED on).
- Low pH. Low pH oxidizes chlorine quickly, making it difficult to maintain desired chlorine levels. Adjust pH levels to re-balance water.
- Warm pool water increases chlorine demand—increase Desired Level% or filter run time.
- Cold water (below 50F) can cause SPS to stop generating (Generating LED flashing).
- Excessive scaling on cell.
- High level of phosphates in pool water.
- Some yellow algae treatments will use chlorine at a very high rate and deplete the residual free chlorine. Manually shock the pool if indicated in the directions on the algae treatment. It still may be a matter of days before the pool returns to “normal” and chlorine tests will show the desired 1-3ppm free chlorine reading.

## **“PCB” displayed and all 4 LEDs are illuminated:**

A possible printed circuit board fault has been detected. Call for service.

## **PLEASE READ THE FOLLOWING CAREFULLY**

THE MANUFACTURER AND/OR DISTRIBUTOR HAS PROVIDED THE PARTS LIST AND ASSEMBLY DIAGRAM IN THIS MANUAL AS A REFERENCE TOOL ONLY. NEITHER THE MANUFACTURER OR DISTRIBUTOR MAKES ANY REPRESENTATION OR WARRANTY OF ANY KIND TO THE BUYER THAT HE OR SHE IS QUALIFIED TO MAKE ANY REPAIRS TO THE PRODUCT, OR THAT HE OR SHE IS QUALIFIED TO REPLACE ANY PARTS OF THE PRODUCT. IN FACT, THE MANUFACTURER AND/OR DISTRIBUTOR EXPRESSLY STATES THAT ALL REPAIRS AND PARTS REPLACEMENTS SHOULD BE UNDERTAKEN BY CERTIFIED AND LICENSED TECHNICIANS, AND NOT BY THE BUYER. THE BUYER ASSUMES ALL RISK AND LIABILITY ARISING OUT OF HIS OR HER REPAIRS TO THE ORIGINAL PRODUCT OR REPLACEMENT PARTS THERETO, OR ARISING OUT OF HIS OR HER INSTALLATION OF REPLACEMENT PARTS THERETO.

**Record Product's Serial Number Here:** \_\_\_\_\_

**Note:** If product has no serial number, record month and year of purchase instead.

**Note:** Some parts are listed and shown for illustration purposes only and are not available individually as replacement parts.



**SAVE THESE INSTRUCTIONS.**



### **Questions, problems, missing parts?**

Before returning to your retailer, our exceptional customer service is here to help.

Call Us: 909.628.0880

Email Us: [customer@xtremepowerusa.com](mailto:customer@xtremepowerusa.com)

Hours of Operation: 9am - 4pm (Monday - Friday)

**PRODUCT MADE IN CHINA**